


MODEL 4A

DAVID BOGEN CO., INC.

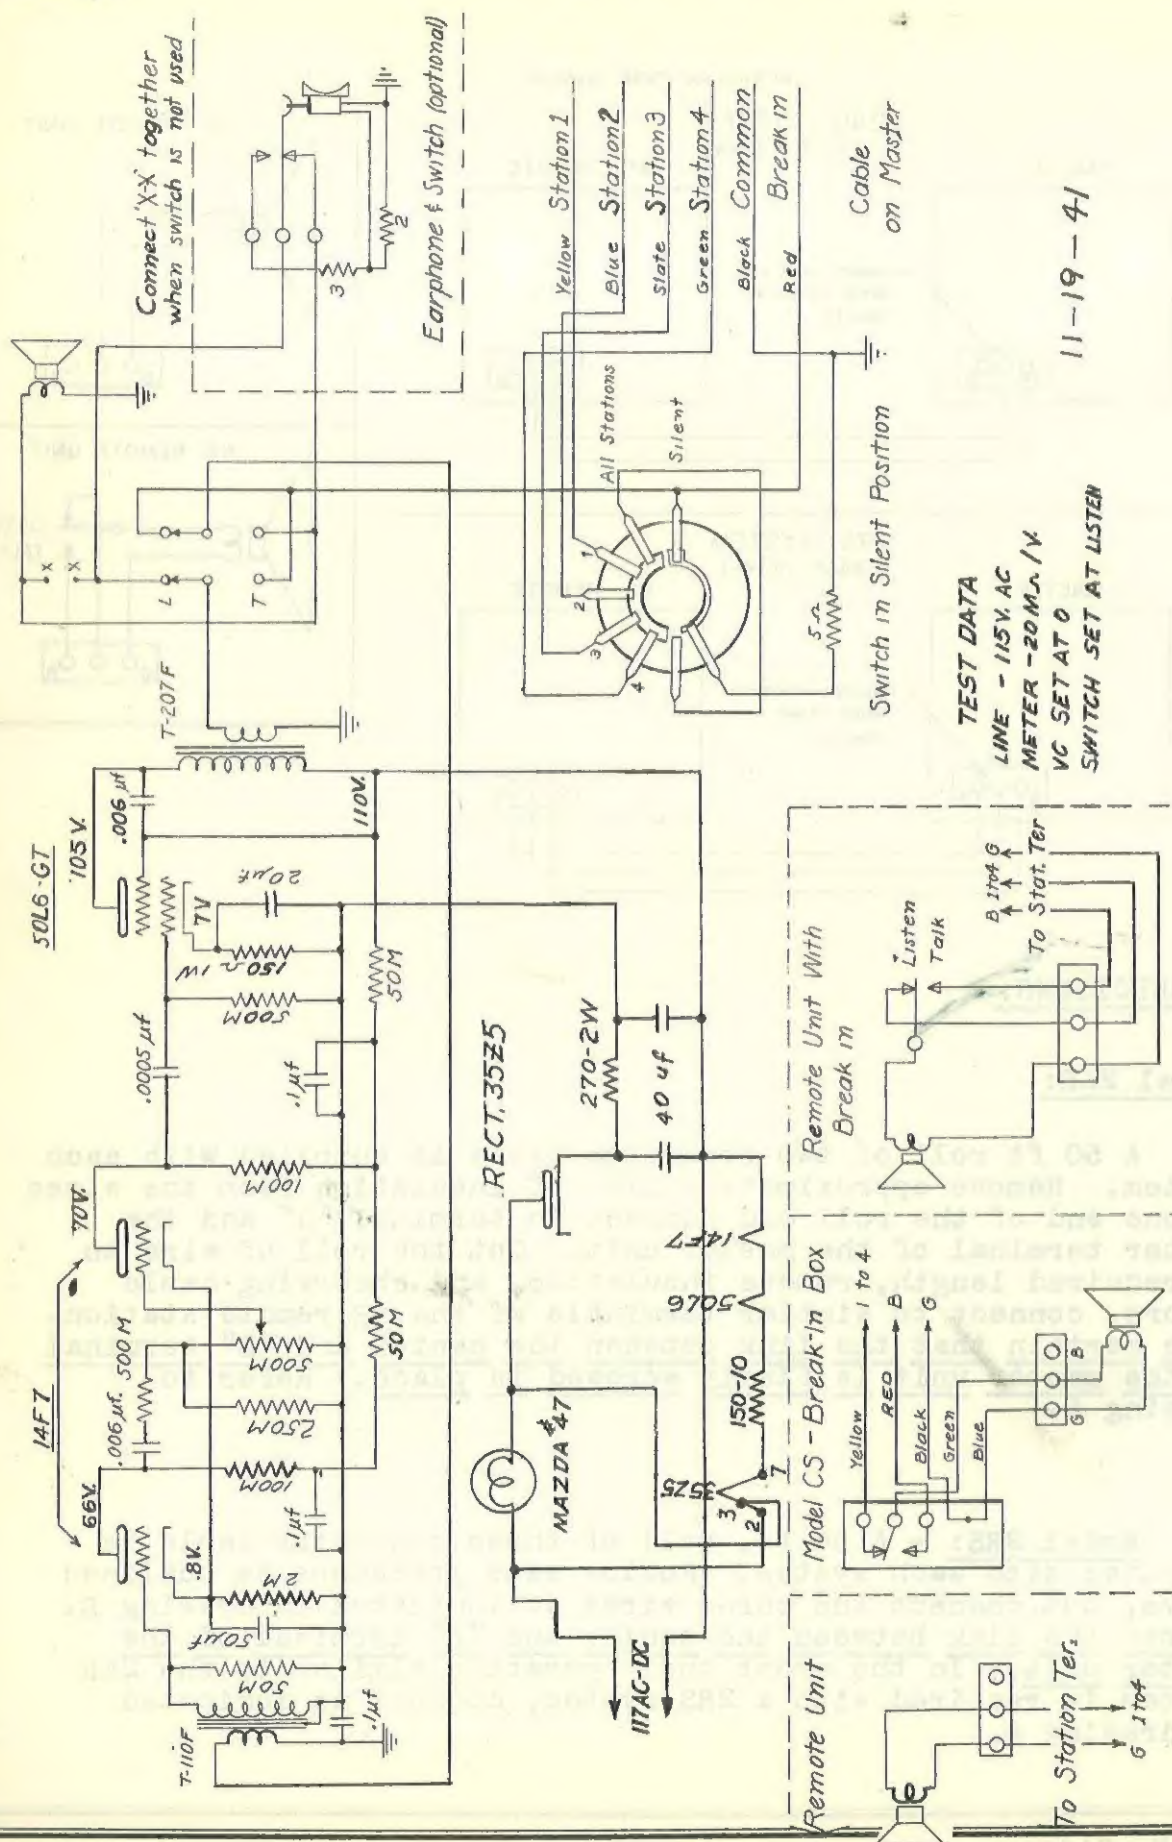

11-19-41

TEST DATA  
LINE - 115V AC  
METER - 20mA/V  
VC SET AT 0  
SWITCH SET AT LISTEN



